I-JOIST Squash Blocks



A squash block is a block of wood or APA Rated Rim Board that is installed adjacent to an I-joist to carry a point load that would otherwise be transmitted to the I-joist.

Squash blocks are required in conventional platform construction where loads from above are transferred down through the floor into the wall or foundation below. This occurs where load-bearing walls fall on floors or posts supporting headers are located within the walls. Beneath these wall and point loads, the I-joists usually do not have enough interior reaction or exterior reaction capacity remaining to safely transfer these loads without risking a web-bearing failure. The solution is to place extra load-carrying members in line with these

loads and insure that these squash blocks carry the load and the I-joists do not.

Blocking members are normally used for line loads like load-bearing walls, however, in the case of point loads, squash blocks are more often specified.

Squash block materials: A lumber squash block is a 2 x 4 or 2 x 6 lumber block that is oriented with the grain of the wood running parallel to the vertical axis of the web of the joist. The squash block is cut just slightly longer than the I-joist is deep, usually 1/16 inch longer. This is done to insure that the block will pick up the vertical load and not the I-joist. The grain is oriented parallel to the vertical axis to minimize the impact of shrinkage by the lumber block.


The minimum grade for lumber squash blocks is Utility grade SPF (south).

APA Performance Rated Rim Board may also be used for the fabrication of squash blocks. As rim board is an engineered wood product and not subject to shrinkage like lumber, cutting the engineered wood squash block 1/16 inch longer is NOT necessary. Select a rim board of 1-joist-compatible depth, cut to width, and install as shown in Figure 1.

Recommendations for I-joists designed in accordance with APA Standard PRI-400:

1. Fully supported squash block capacities can be found in Figure 1. As squash blocks are usually placed in pairs – to minimize load eccentricity – the values given in Figure 1 are for pairs of squash blocks. Often times, the builder will simply match the width of the squash blocks with the width of posts used from above.

For example: Assume a squash block is required to carry the load of a post above that is made up of (3) $2 \times 4s$. The total width of the post is 4-1/2 inches (3×1.5 inches = 4-1/2 inches). If the squash block is to be made up of 1-1/8 inch rim board, four squash blocks would be required (4×1 -1/8 inches = 4-1/2 inches). If the squash block is to be made up of 1 inch Rim Board, five squash blocks would be required (5×1 inch = 5 inches).

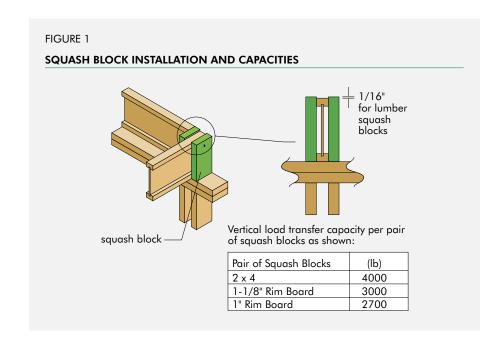



- 2. Lumber squash blocks are to be cut 1/16 inch longer than the depth of the I-joist to insure that the squash block carries the load and the I-joist does not.
- 3. Squash blocks are installed with the wide side of the block flush with the edges of the I-joist flanges. When possible, they should be fully seated on the top/sole plate below. They should be attached to the top and bottom flange of the I-joist with one 8d nail at each location. For lumber squash blocks, the extra 1/16 inch of the squash block is oriented to stick up above the surface of the top flange of the I-joist.
- 4. The use of squash blocks in lieu of blocking for the entire length of a loadbearing wall is not recommended. They could be used, however, to transfer vertical loads in an occasional joist space to allow for passage of duct. The building codes, however, require blocking under loadbearing walls to provide lateral stability and prevent rollover of the joists, as well as to transfer vertical load. While the squash blocks can transfer the vertical loads, they have no ability to provide lateral stability. From an engineering perspective, leaving out an occasional blocking panel for the passage of plumbing or ventilation ducts and putting in squash blocks at this location could be justified.

We have field representatives in most major U.S. cities and in Canada who can help answer questions involving APA and APA EWS trademarked products. For additional assistance in specifying engineered wood products or systems, get in touch with your nearest APA regional office.

Call or write:

APA – THE ENGINEERED WOOD ASSOCIATION HEADQUARTERS

7011 So. 19th St. • P.O. Box 11700 Tacoma, Washington 98411-0700 (253) 565-6600 • Fax: (253) 565-7265



PRODUCT SUPPORT HELP DESK

(253) 620-7400 E-mail Address: help@apawood.org

(Offices: Bournemouth, United Kingdom; Hamburg, Germany; Mexico City, Mexico; Tokyo, Japan.)

The product use recommendations in this publication are based on the continuing programs of laboratory testing, product research, and comprehensive field experience of Engineered Wood Systems. However, because EWS has no control over quality of workmanship or the conditions under which engineered wood products are used, it cannot accept responsibility for product performance or designs as actually constructed. Because engineered wood product performance requirements vary geographically, consult your local architect, engineer or design professional to assure compliance with code, construction, and performance requirements.

Form No. EWS A755 Issued January 2001/0100

